
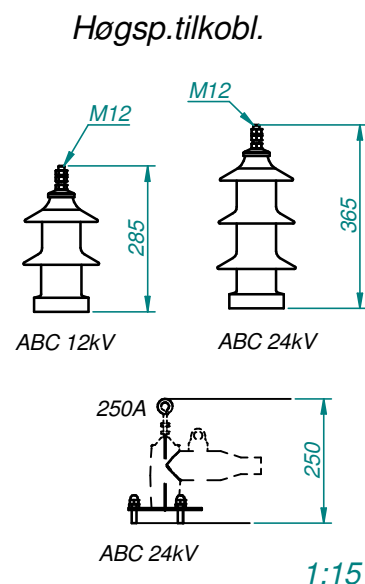
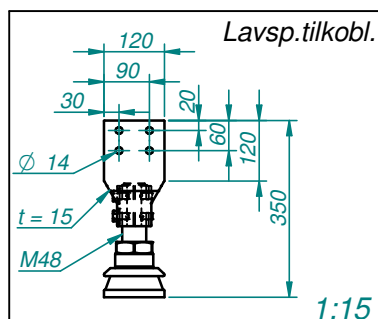
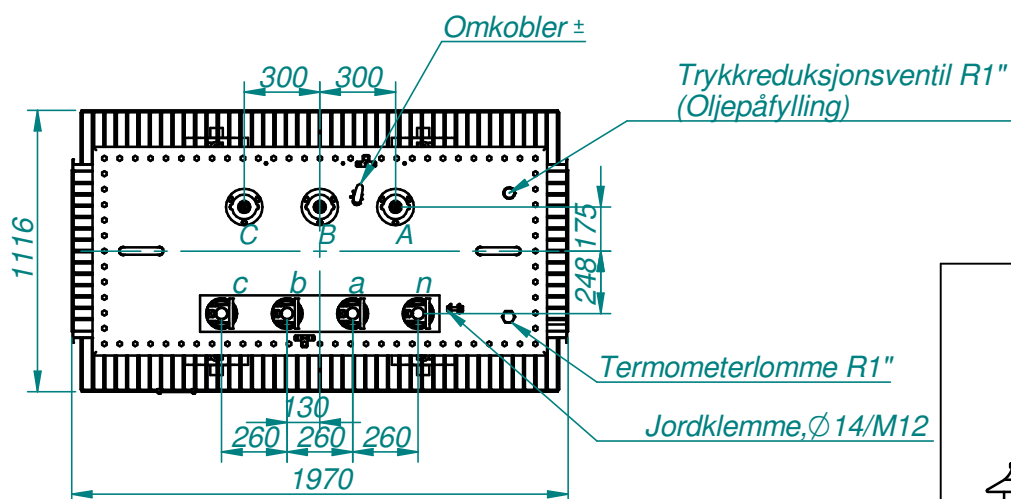


Rev nr	Endring	Godkj. Dato

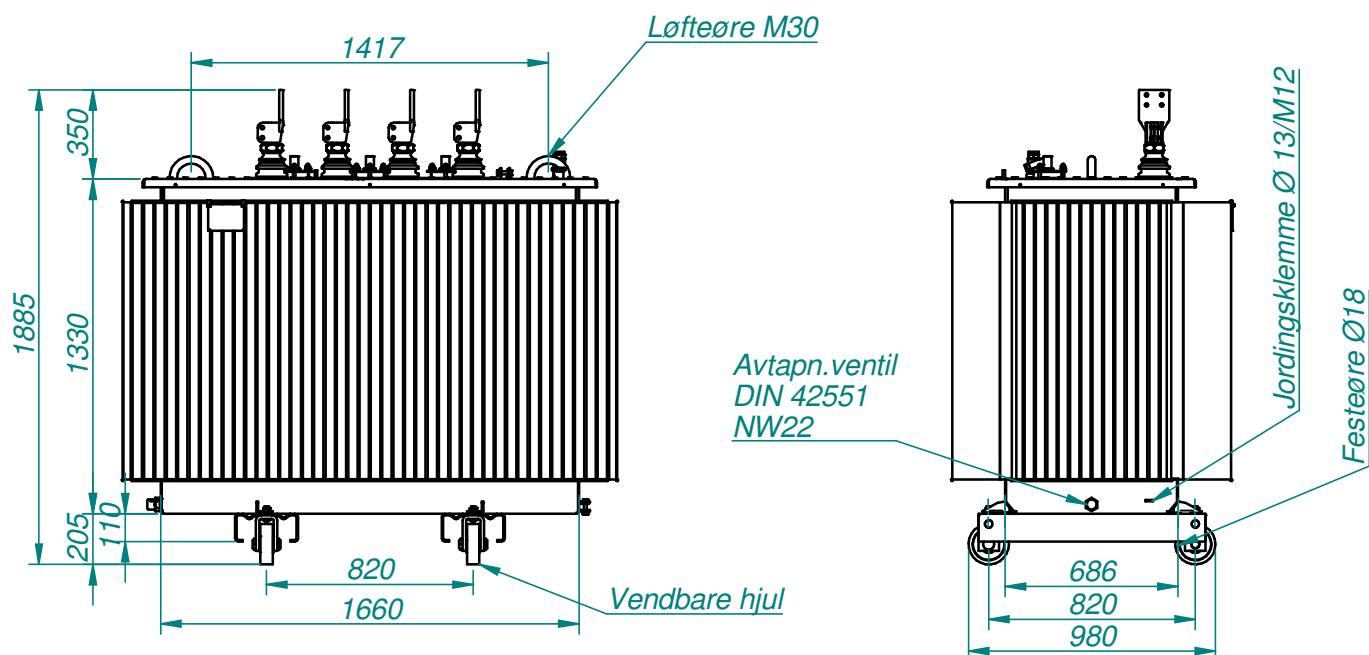

Målskisse

2000 kVA 3-fase oljeisol. transf.
Type OTW81078 (415V) Dyn11

Skala:

1:30
A4

Projeksjons-
metode

Dato:	13.05.2015
-------	------------

Mod. av: *berrag*

Kontroll:

Erstatning for:

Erstattet av:

Tgn. nr:

Rev. nr:

MØRE
TRAFO

MØRE TRAFØ AS
N-6230 SYKKYLVEN

T133438