

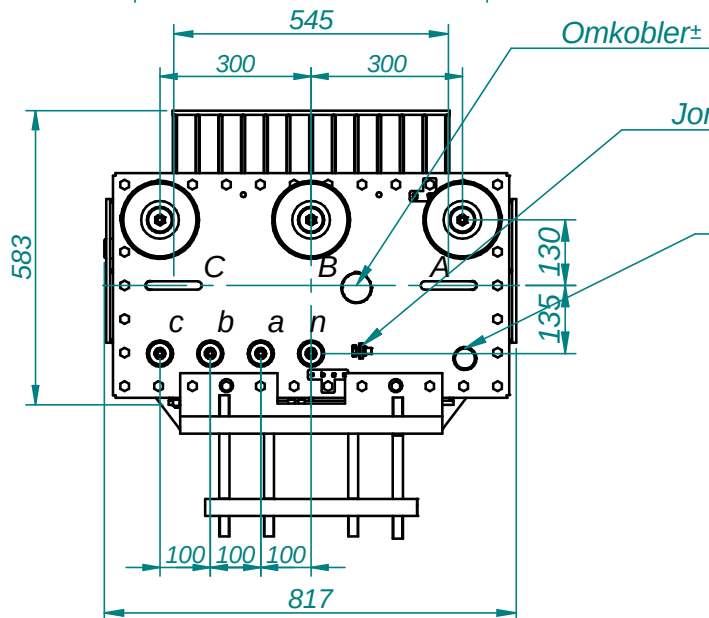
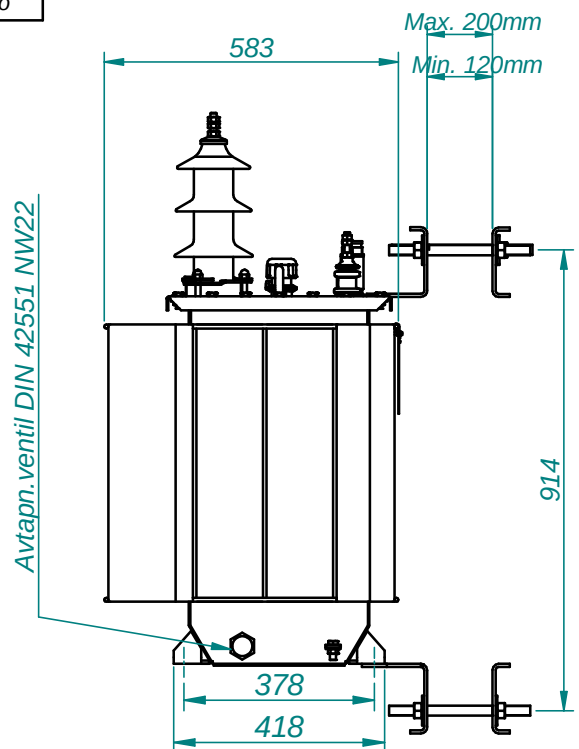


a	Mål 817 og 583 var før 786 og 565	SS 27.09.2016
Rev nr	Endring	Godkj. Dato

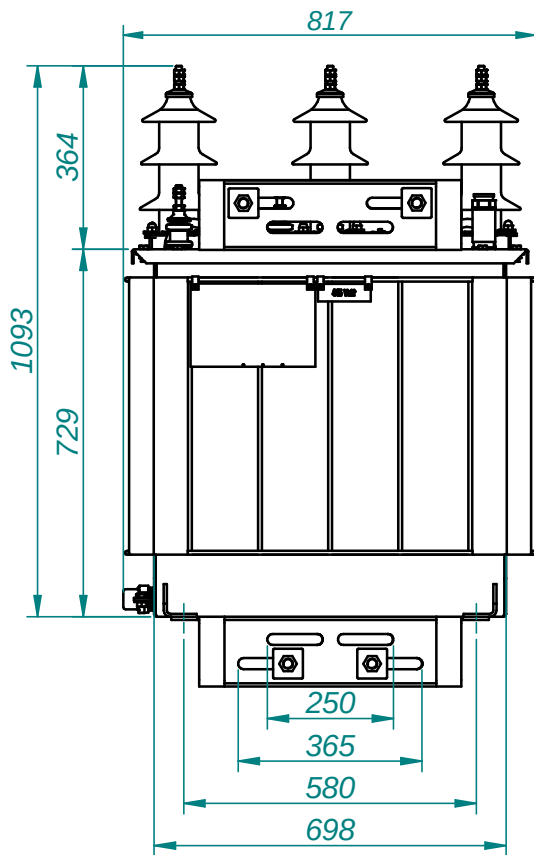


Bem:
Ventilavlederfeste, termometerlomme,
stolpefeste og mothold er
ekstra-utstyr og må bestilles


Høgsp.tilkobl.
250A



ABC 12kV



Lavsp.tilkobl.



Målskisse

25kVA, 22000±2x2,5%/415V, Yzn11
OTK 2540, 3-fase oljeisol.transf.

Skala:

1:15
A4



Dato: 12.05.2015

Mod. av: berrag

Kontroll:

Erstatning for:

Erstattet av:

Tgn. nr:

Rev. nr:

**MØRE
TRAFO**

MØRE TRAFO AS
N-6230 SYKKYLVEN

T133436

a
Side 1 av 1